

# MAHARASHTRA POLLUTION CONTROL BOARD

Phone : 4010437/4020781  
/4037124/4035273  
Fax : 24044532/4024068 /4023516  
Email : rohq@mpcb.gov.in  
Visit At : <http://mpcb.gov.in>



Kalpataru Point, 3rd & 4th floor, Sion-  
Matunga Scheme Road No. 8, Opp. Cine  
Planet Cinema, Near Sion Circle, Sion (E),  
Mumbai - 400 022

Red/L.S.I

Consent order No: Format 1.0/BO/ROHQ/EIC-PN-21317-14/CR/CC - 6970

Date: 24/07/2014

To,

M/s. Bramhacorp Ltd,  
(Le Meridian Hotel),  
100/101, R.B.M. Road,  
Sangamwadi, Dist. Pune.

Sub: Renewal of Consent to Operate for Hotel/Resort activity.  
RED category.

Ref : Minutes of CC meeting held on 14.07.2014.

Your application no: CR1404000239.  
Dated: 29/03/2014.

For: Renewal of Consent to Operate for hotel/resort activity.

Under Section 26 of the Water (Prevention & Control of Pollution) Act, 1974 & under Section 21 of the Air (Prevention & Control of Pollution) Act, 1981 and Municipal Solid Waste (Management & Handling) Rule 2000 and E-Waste (Management & Handling Rule 2011 is considered and the consent is hereby granted subject to the following terms and conditions and as detailed in the schedule I, II, III & IV annexed to this order:

1. The consent to Operate is granted for a period upto:- 31/05/2017.
2. The Capital investment of the Hotel is Rs. 63.44 Crs. (As per CA Certificate).
3. The Consent to operate is valid following activity :-

Sr. No.	Product Name	Rooms
1	Five Star Hotel (Lodging & Boarding activity with swimming pool and Laundry activity on total BUA of 28,500 sq. mtrs.	177.0

4. Conditions under Water (P&CP), 1974 Act for discharge of effluent:

Sr. no.	Description	Permitted quantity of discharge (CMD)	Standards to be achieved	Disposal
1.	Trade effluent	12.0	As per Schedule -I	60% shall be reused & recycled and remaining shall be discharged in municipal sewer.
2.	Domestic effluent	50.0		

5. Conditions under Air (P&CP) Act, 1981 for air emissions:

Sr. No.	Description of stack / source	Number of Stack	Standards to be achieved
1.	DG sets (625 x 2 KVA)	2	As per Schedule -II
2	Boiler (3 Nos.)	1	As per Schedule - II

6. Conditions under Municipal Solid Waste (Management and Handling Rule,2000

Sr. No	Type Of Waste	Quantity	UOM	Treatment	Disposal
1.	Biodegradable Waste	200.0	Kg/Day	On site Composting	Used as manure
2.	Non Biodegradable Waste	100.0	Kg/Day	Segregation	By sale
3.	STP Sludge	50.0	Kg/Day	---	Used as manure

7. This Board reserves the right to review, amend, suspend, revoke etc. this consent and the same shall be binding on the industry.
8. This consent should not be construed as exemption from obtaining necessary NOC/permission from any other Government agencies.

For and on behalf of the  
Maharashtra Pollution Control Board

( Rajeev Kumar Mital, IAS )  
Member Secretary

Received Consent fee of -

Sr. No.	Amount(Rs.)	DD. No.	Date	Drawn On
1	3,00,100/-	001813	24/03/2014	HDFC Bank

Copy to:

1. Regional Officer, MPCB, Pune and Sub-Regional Officer, Pune- I, They are directed to ensure the compliance of the consent conditions.
2. Chief Accounts Officer, MPCB, Mumbai.
3. CC/CAC desk- for record & website updation purposes.

Schedule-I

Terms & conditions for compliance of Water Pollution Control:

- 1) A] As per your consent application, you have proposed to provide the sewage treatment system with the design capacity of 75 CMD.
- B] The Applicant shall operate the sewage treatment system to treat the sewage so as to achieve the following standards/ prescribed under EP Act, 1986 and Rules made there under from time to time, whichever is stringent.

1	pH	Not to exceed	6.5 to 9.0
2	Suspended Solids	Not to exceed	100 mg/l.
3	BOD 3 Days 27 degree C	Not to exceed	100 mg/l.
4	Detergent	Not to exceed	01 mg/l.


C] The treated domestic effluent shall be 60% recycled and reused for flushing, fire fighting and cooling of Air conditioners etc. The remaining shall be discharged into Municipal sewer/ land after conforming to above standards. The firm shall affix the separate meter for ensurance of 60% recycling of treated sewage and keep the records of the same. In no case effluent shall find its way to any water body directly /indirectly at any time.

- 2) The Board reserves its rights to review plans, specifications or other data relating to plant setup for the treatment of water, works for the purification thereof & the system for the disposal of sewage or trade effluent or in connection with the grant of any consent conditions. The Applicant shall obtain prior consent of the Board to take steps to establish the unit or establish any treatment and disposal system or an extension or addition thereto.
- 3) The firm shall ensure replacement of pollution control system or its parts after expiry of its expected life as defined by manufacturer so as to ensure the compliance of standards and safety of the operation thereof.
- 4) In case, the water consumption of the project is not covered under the water consumption of local body, in that situation, the project proponent shall submit the CESS Returns in the prescribed format given under the provision of Water (Prevention & Control of Pollution) Cess Act, 1977 and Rules made there under for various category of water consumption.

In case the water consumption is duly assessed under the quantity of water consumption of local body, the project proponent shall submit certificate to that effect from the concern local body with the request not to assess CESS on their water consumption, being already assessed on the water consumption of local body.

Sr. no.	Purpose for water consumed	Water consumption quantity (CMD)
1.	Domestic purpose	75.0
2.	Industrial cooling /Boiler	25.0

- 5) The firm shall provide Specific Water Pollution control system as per the conditions of EPAct,1986 and rule made there under from time to time.



**Schedule-II**

**Terms & conditions for compliance of Air Pollution Control:**

1. As per your application, you have proposed to erect following stack (s) and to observe the following fuel pattern-


Sr. No.	Stack Attached To	Height in Mtrs. (Above roof top)	Type of Fuel	Quantity	SO <sub>2</sub> Kg/D
1	Boiler (3 Nos)	36.90	HSD	28.0 L/Hr	11.4
2	DG sets 2 Nos (625 KVA)	5.0	HSD*	90.0 L/Hr	36.7

\* D.G. Set shall be operated only in case of power failure.

2. The applicant shall operate and maintain above mentioned air pollution control system, so as to achieve the level of pollutants to the following standards:

Particulate matter	Not to exceed	150.00 mg/Nm <sup>3</sup> .
--------------------	---------------	-----------------------------

3. The Applicant shall obtain necessary prior permission for providing additional control equipment with necessary specifications and operation thereof or alteration or replacement/alteration well before its life come to an end or erection of new pollution control equipment.
4. The Board reserves its rights to vary all or any of the condition in the consent, if due to any technological improvement or otherwise such variation (including the change of any control equipment, other in whole or in part is necessary)

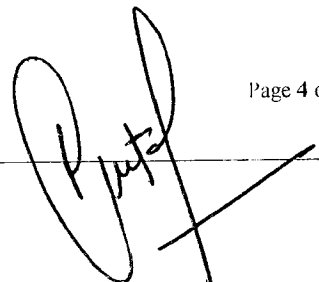

**Schedule-III**  
**Details of Bank Guarantees**

Sr. No.	Consent (C to E/O/R)	Amt of BG Imposed	Submission Period	Purpose of BG	Compliance Period	Validity Date
1	C to R	Rs. 5 lakhs	15 days	Towards Operation and maintenance of STP.	31/05/2017	30/09/2017

